


New England Division

Drought Contingency Plan

SEPTEMBER 1993

Hodges Village Dam, Oxford, Massachusetts

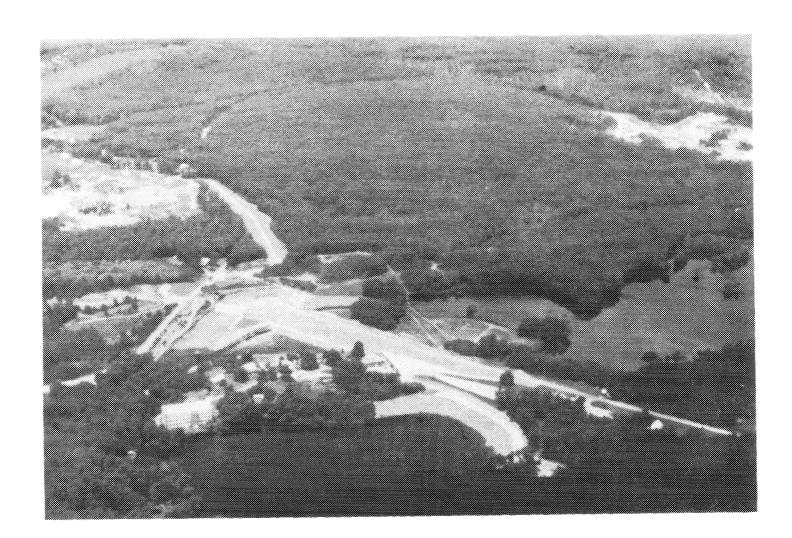

REPORT D	Form Approved OMB No. 0704-0188		
gathering and maintaining the data needed, a	and comoleting and reviewing the collection- ins for reducing this burden, to Washington i	ot information	ing instructions, searching ensuing data sources, I this burden estimate or any other espect of this rimation Operations and Reports, 1215 Jetterson 704-01887, Washington, OC 20503.
1. AGENCY USE ONLY (Leave ora	September 199	3. REPORT TYPE AND O Drought Cont	
4. HTLE AND SUBTITLE Drought Contingend Hodges Village Dam	cy Plan m, Oxford, Massachus	S.	FUNDING NUMBERS
6. AUTHOR(S) U.S. Army Corps of New England Divisi	f Engineers ion		
7. PERFORMING ORGANIZATION N U.S. Army Corps of 424 Trapelo Road Waltham, Massachus	Engineers, New Engl	1	PERFORMING ORGANIZATION REPORT NUMBER
9. SPONSORING/MONITORING AG Commonwealth of Ma Environmental Affa Protection	SENCY NAME(S) AND ADDRESS(I Issachusetts Executiveirs, Department of E	re Office of	SPONSORING / MONITORING AGENCY REPORT NUMBER
12a. DISTRIBUTION / AVAILABILITY	STATEMENT	1980's.	ht contingency plans
Approved for public Distribution is un	c release limited		
limits, evaluation of purposes, and the eff Due to a variety beneficiaries, the Co Environmental Affairs	tingency plan includibility of reallocatification of water quality, discretes on the environm of reasons, mainly commonwealth of Massacs are not interested drought contingency	ton of reservoir stocussion of impacts of ment. topography and distactive (in sponsoring emergences	ance from potential Office of
drought; emergency	storage; Hodges Vi	llage Dam	15. NUMBER OF PAGES 38 16. PRICE CODE
17. SECURITY CLASSIFICATION OF REPORT Unclassified	18. SECURITY CLASSIFICATION OF THIS PAGE Unclassified	19. SECURITY CLASSIFICATION OF ABSTRACT Unclassified	ON 29. LIMITATION OF ABSTRACT

GENERAL INSTRUCTIONS FOR COMPLETING SF 298

The Report Documentation Page (RDP) is used in announcing and cataloging reports. It is important that this information be consistent with the rest of the report, particularly the cover and title page. Instructions for filling in each block of the form follow. It is important to stay within the lines to meet optical scanning requirements.

- Block 1. Agency Use Only (Leave blank).
- Block 2. Report Date. Full publication date including day, month, and year, if available (e.g. 1 Jan 88). Must cite at least the year.
- Block 3. Type of Report and Dates Covered. State whether report is interim, final, etc. if applicable, enter inclusive report dates (e.g. 10 Jun 87 30 Jun 88).
- Block 4. <u>Title and Subtitle</u>. A title is taken from the part of the report that provides the most meaningful and complete information. When a report is prepared in more than one volume, repeat the primary title, add volume number, and include subtitle for the specific volume. On classified documents enter the title classification in parentheses.
- Black 5. Funding Numbers. To include contract and grant numbers; may include program element number(s), project number(s), task number(s), and work unit number(s). Use the following labels:

C - Contract

PR - Project TA - Task

G - Grant PE - Program

. Element

WU - Work Unit
Accession No.

- Block 6. <u>Author(s)</u>. Name(s) of person(s) responsible for writing the report, performing the research, or credited with the content of the report. If editor or compiler, this should follow the name(s).
- Block 7. <u>Performing Organization Name(s)</u> and <u>Address(es)</u>. Self-explanatory.
- Block 8. <u>Performing Organization Report</u>
 <u>Number.</u> Enter the unique alphanumeric report number(s) assigned by the organization performing the report.
- Black 9. Spansoring/Monitoring Agency Name(s) and Address(es). Self-explanatory.
- Black 10. <u>Sponsoring/Monitoring Agency</u> Report Number. (If known)
- Block 11. <u>Supplementary Notes</u>. Enter information not included elsewhere such as: Prepared in cooperation with...; Trans. of...; To be published in.... When a report is revised, include a statement whether the new report supersedes or supplements the older report.

Block 12a. <u>Distribution/Availability Statement.</u>
Denotes public availability or limitations. Cite any availability to the public. Enter additional limitations or special markings in all capitals (e.g. NOFORN, REL, ITAR).

DOD - See DoDD 5230.24, *Distribution Statements on Technical Documents.*

DOE - See authorities.

NASA - See Handbook NHB 2200.2.

NTIS . Leave blank.

Block 12b. Distribution Code.

DOD - Leave blank.

DOE - Enter DOE distribution categories from the Standard Distribution for Unclassified Scientific and Technical Reports.

NASA - Leave blank. NTIS - Leave blank.

- Block 13. Abstract. Include a brief (Maximum 200 words) factual summary of the most significant information contained in the report.
- Block 14. <u>Subject Terms</u>. Keywords or phrases identifying major subjects in the report.
- Block 15. <u>Number of Pages</u>. Enter the total number of pages.
- Block 16. <u>Price Code</u>. Enter appropriate price code (NTIS only).
- Blocks 17. 19. Security Classifications. Selfexplanatory. Enter U.S. Security Classification in accordance with U.S. Security Regulations (i.e., UNCLASSIFIED). If form contains classified information, stamp classification on the top and bottom of the page.
- Block 20. <u>Limitation of Abstract</u>. This block must be completed to assign a limitation to the abstract. Enter either UL (unlimited) or SAR (same as report). An entry in this block is necessary if the abstract is to be limited. If blank; the abstract is assumed to be unlimited.

SUMMARY

In the 1990's NED started updating drought contingency plans that were previously developed in the 1980's for some of our reservoirs. One of the requirements to updating the drought contingency plans, to make them fully implementable, is state sponsorship. If there is no state sponsorship then a nonfeasible plan will be published for that particular project.

In letter, dated August 11, 1992 (copy attached), the Commonwealth of Massachusetts Executive Office of Environmental Affairs, Department of Environmental Protection (DEP) withdrew its support as a sponsor for the drought contingency plan at Hodges Village Dam. The DEP indicated for a variety of reasons, mainly topography and distance from potential beneficiaries, they currently are not interested in sponsoring emergency storage at the project. Therefore, the Massachusetts DEP is not interested in entering into a contract with the Corps.

Since there is no state sponsorship for drought storage at Hodges Village Dam, the drought contingency plan previously developed is presented herein for informational purposes only. If, at some future date, the state were to indicate an interest, drought contingency storage will be re-evaluated and this report updated as necessary to respond to the state request.

DROUGHT CONTINGENCY STORAGE FOR EMERGENCY WATER SUPPLY PURPOSES AT HODGES VILLAGE DAM IS NOT IMPLEMENTABLE

Commonwealth of Massachusetts Executive Office of Environmental Affairs

Department of **Environmental Protection**

Daniei S. Greenbaum...

August 11, 1992

Mr. Richard D. Reardon Director of Engineering Department of the Army New England Division Corps of Engineers 424 Trapelo Road Waltham, Massachusetts 02254-9149

Dear Mr. Reardon:

I am responding to your letter of June 2, 1992 regarding the Commonwealth's interest in the development of drought storage capacity at several Corps dams. After having reviewed the water supply situation in the communities proximate to the reservoirs, the Department has not identified a user for the water for the purposes described in your letter. Based on this determination, the Department will not enter into a contract with the Corps at this time.

I thank you for the offer of assistance and look forward to working with your office on projects of mutual interest in the future.

Sincerely,

Assistant Commissioner

cc: Charles Joyce



DEPARTMENT OF THE ARMY NEW ENGLAND DIVISION, CORPS OF ENGINEERS **424 TRAPELO ROAD** WALTHAM, MASSACHUSETTS 02254-9149

June 2, 1992

Engineering - Water Control

Ms. Arleen O'Donnell Assistant Commissioner, Resource Protection Department of Environmental Protection One Winter Street Boston, Massachusetts 02108

Dear Ms. O'Donnell:

The New England Division, Corps of Engineers, is currently updating previously developed plans for drought contingency storage at some of our reservoirs in Massachusetts. We have identified these projects as having merit in providing a source of water supply during drought emergency conditions. Each reservoir has been initially screened by this office and an appropriate plan developed. Listed below are names and locations of each candidate reservoir in Massachusetts. Attachments 1 through 7 present fact sheets with pertinent information for each project, and attachments 8 through 10 show locations. In addition, the study for Tully Lake in Royalston, Massachusetts, is nearing completion, and is in the process of being finalized with the Department of Environmental Protection. Our mutual efforts were unable to identify a community or State agency that would be interested in emergency storage at Tully Lake; therefore, the Department of Environmental Protection is not interested in entering into a contract with the Corps.

1ame	
	•

East Brimfield Lake* Westville Lake West Hill Dam Littleville Dam Knightville Dam Hodges Village Dam Buffumville Dam

Location

Sturbridge Sturbridge Uxbridge Huntington Huntington Oxford Charlton

^{*} Currently scheduled for study in fiscal year 1993

The Drought Contingency Plan (DCP) presents a basic planning aid assessment of Corps projects as a potential emergency short term water supply source during a State-declared drought emergency, with each DCP identifying the following:

- a. Hydrologic assessment of drought storage potential.
- b. Standard operating procedure for drought storage and releases.
 - c. State sponsor for the plan and potential beneficiary.
- d. Draft Drought Emergency Water Contract identifying conditions of the emergency water storage, withdrawal, and cost.

Previously, we were requesting interest by the Commonwealth of Massachusetts on a project-by-project basis. effort to reassess and update the entire drought contingency program, we are requesting your agency forward a letter to this office expressing interest in participation in the program for all candidate reservoirs within the Commonwealth. You are, therefore, requested to review the attached list of projects, solicit the surrounding towns for interest, determine your interest in all or some of them and provide us with a prioritized list. Your letter should identify the appropriate State agency to act as sponsor for the DCP and signatory to the contract, potential water supply user, and method of transporting water (i.e., reservoir releases, trucking, etc.) for each project. When determining a user, surface water treatment facilities should be available. If treatment facilities are not available within a specific region, you should carefully consider if sponsoring a particular project is feasible. The Commonwealth would incur no costs for the preparation of the DCP or for the water itself until such time as the Governor declared a drought emergency in the area in question and a decision made to begin emergency storage at the particular dam.

If you have any questions regarding this request or would like to set up a meeting to discuss the possibilities of

drought contingency storage, please contact Mr. Steven Simmer of my staff at 617-647-8524.

Sincerely,

Richard D. Reardon Director of Engineering

Attachments

CF:
Mr. Simmer - 115N
Mr. Joyce - 114S
Reading File
Engr Dir Files - 112S

THAMES RIVER BASIN FRENCH RIVER WATERSHED

DROUGHT CONTINGENCY PLAN HODGES VILLAGE DAM OXFORD, MASSACHUSETTS

SEPTEMBER 1983

NEW ENGLAND DIVISION, CORPS OF ENGINEERS 424 TRAPELO ROAD WALTHAM, MASSACHUSETTS 02254

DROUGHT CONTINGENCY PLAN HODGES VILLAGE DAM

TABLE OF CONTENTS

<u>Paragraph</u>	Subject	Page
1	PURPOSE AND SCOPE	1
2	AUTHORIZATION	1
3	PROJECT AUTHORIZATION CONDITIONS	1
4	PROJECT DESCRIPTION	1
5	PRESENT OPERATING REGULATIONS	2
a b c	Normal Periods Flood Periods Operating Constraints (1) Minimum Releases (2) Maximum Releases	2 2 2 2 2
6	MONITORING OF HYDROLOGIC CONDITIONS	2
7	DESCRIPTION OF EXISTING WATER SUPPLY CONDITIONS	3
a b c	General Water Supply Systems South-Central Massachusetts	3 3
d	Water Suppliers Population Projections	3 3
8	POTENTIAL FOR WATER SUPPLY REALLOCATION	7
a b	General Drought Contingency Storage Effects of Regulated Flows	7 7 8

Paragraph	<u>Subject</u>	<u>Page</u>
9	WATER QUALITY EVALUATION	8
а	Water Quality Classification	8
Ь	Existing Water Quality	8 8 9
С	Soil Inundation Studies	9
d	Water Quality Requirements for	
	Drought Storage	9
е	Effects of Drought Storage	9
10	DISCUSSION OF IMPACTS	10
a	General	10
b	Flood Control	10
С	Recreation	11
d	Project Operations	11
e ,	Effect on the Aquatic System	7.7
e. f	Effects on the Terrestiral Environment	12
g	Historic and Archeological Resources	13
11	STUDY OF MODIFICATION OF HODGES	
	VILLAGE DAM	13
a	General	. 13
b	Effects of Drought Storage	14

LIST OF TABLES

<u>Table</u>	<u>Title</u>	Page
1	Major Water Suppliers - South- Central Massachusetts	4,5
2	Population Projections - South- Central Massachusetts	6

LIST OF PLATES

<u>Plate</u>	<u>Title</u>					
1	Thames River Basin Map					
2	Hodges Village Dam - Area and Capacity					
3	Drought Contingency Storage Versus Flow Duration					
4	Pertinent Data - Hodges Village Dam					

DROUGHT CONTINGENCY PLAN HODGES VILLAGE DAM

PURPOSE AND SCOPE

The purpose of this study and report was to develop and set forth a drought contingency plan of operation for Hodges Village Dam that would be responsive to public needs during drought periods and identify possible modifications to project regulation within current administrative and legislative constraints. This evaluation was based on preliminary studies utilizing readily available information. The scope of this drought contingency plan includes a description of existing water supply conditions, the possibility of reallocation of reservoir storage within specified limits, water quality evaluation, discussion of impacts on other project purposes, effects on the environment, and summarv and conclusions.

2. AUTHORIZATION

The authority for the preparation of drought contingency plans is contained in ER 1110-2-1941 which provides that water control managers will continually review and, when appropriate, adjust water control plans in response to changing public needs. Drought contingency plans will be developed on a regional, basinwide and project basis as an integral part of water control management activities.

PROJECT AUTHORIZATION CONDITIONS

Hodges Village Dam was authorized by the Flood Control Act of 18 August 1941 (Public Law 228, 77th Congress). In addition, Section 4 of the Flood Control Act of 22 December 1944 (Public Law 534, 78th Congress) authorized recreational use of the reservoir area.

PROJECT DESCRIPTION

Hodges Village Dam, completed in 1959, in Oxford, Massachusetts, is located on the French River 15 miles upstream from its confluence with the Quinebaug River at Hodges Village. A map of the Thames River Basin is shown on plate 1. The reservoir has a total storage capacity of 13,250 acre-feet (4.3 billion gallons), equivalent to 8 inches of runoff from a drainage area of 31.1 square miles.

The outlet works consist of two 5 x 6-foot conduits having inverts at elevation 465.5 feet NGVD and each provided with one electrically controlled service gate 5' wide x 6' high. A capacity table is shown on plate 2, and a summary of pertinent data at Hodges Village Dam is contained on plate 4.

5. PRESENT OPERATING REGULATIONS

- a. Normal Periods. During normal (non-flood) conditions, the gate openings are 0-3' and reservoir outflow equals inflow. This gate setting automatically restricts discharges so that significant reservoir releases will not occur during unexpected increases in runoff. No permanent pool is maintained during normal periods or during the winter season.
- b. Flood Periods. The Hodges Village project is operated in concert with other projects in the basin to reduce flooding on the downstream French and Quinebaug Rivers. Operation for floods may be considered in three phases: phase I appraisal of storm and river conditions during the development of a flood, phase II flow regulation and storage of flood runoff at the reservoir, and phase III emptying the reservoir during recession of the flood. The regulation procedures are detailed in the Master Water Control Manual for the Thames River Basin.

c. Operating Constraints

- (1) <u>Minimum Releases</u>. A minimum release of about 10 cfs (6.5 mgd) is maintained during periods of flood regulation in order to sustain downstream fish life.
- (2) <u>Maximum Releases</u>. The maximum nondamaging discharge capacity of the channel immediately downstream from Hodges Village Dam is about 525 cfs. Releases at or near this rate can be expected whenever peak inflows have exceeded this value and meteorological and hydrologic conditions permit.

MONITORING OF HYDROLOGIC CONDITIONS

The Reservoir Control Center directs the reservoir regulation activities at 28 New England Division flood control dams, and continually monitors rainfall, snowcover, and runoff conditions throughout the region. When any of these parameters have been well below

normal for several months and it appears that possible drought conditions might develop, the Corps Emergency Operations Center (EOC) will be so informed. The EOC will then initiate discussions with the respective State agencies and other in-house Corps elements to review possible drought concerns and future Corps initiatives.

7. DESCRIPTION OF EXISTING WATER SUPPLY CONDITIONS

- a. <u>General</u>. The area of concern is the south-central portion of Massachusetts, including portions of Worcester, Hampden, and Middlesex counties. Table I contains information about public water suppliers in the area based on information provided by the Massachusetts Department of Environmental Management. Of the 36 communities in the study area, 31 are served by public systems. No data is available for those communities dependent on private individual supplies.
- b. Water Supply Systems. The primary objective of this analysis was to accumulate available data regarding water supply systems in the vicinity of Hodges Village Dam that could benefit from storage at the project, and to present the data in a manner portraying existing water supply conditions. Projections of future demands were not developed because this study addresses only modifications in the operational procedure at Hodges Village Dam in order to provide storage for water supply purposes when drought conditions exist, and not to meet normal water supply demands at some future date.
- c. South-central Massachusetts Water Suppliers. As noted in table 1, the data given for each water supplier includes: community served, estimated population served by the system, source of supply (ground or surface water), average day and maximum day demands for 1980, estimated safe yield of the source, and any further information available on the source of supply. An analysis of the adequacy of existing sources during drought conditions has not been performed. The information has been accumulated to present a summary of the existing water supply conditions for the south-central Massachusetts area.
- d. <u>Population Projections</u>. Population projections for communities in south-central Massachusetts are given in table 2 to show population trends for each community potentially affected by a prolonged dry period. The projections were developed by the Massachusetts Office of State Planning for the "208" Areawide Wastewater Management Program,

TABLE 1

MAJOR WATER SUPPLIERS - SOUTH CENTRAL MASSACHUSETTS

		•		1980 Demands			**************************************
Company or Agency	Town Served	Est.Population Served -1980	Source of Supply (SW or GW)	Avg. Day (MGD)	Max. Day (MGD)	Safe Yield (MGD)	Comments
Elm Hill Water District Auburn Water District Woodland Water District	Auburn	600 9,501 540	GM	1.07 0.027	1.80 0.041	2.5	Supplied by Worcester(SW/CW) 6 wells Supplied by Worcester(SW/CW)
Blackstone Water Dept.	Blackstone	6,158	CW	0.37	0.63	0.78	2 Wells, 1 standby
	Brimfield		No Public Water S	Supply			\$
Brookfield Water Dept.	Brookfield	1,400	GW	0.078	0.117	0.40	3 Wells
	Charlton		No Public Water S	Supply			
Douglas Water Dept.	Douglas	2,611	GW	0.18	0.46	0.50	l wellfield, 1 well
Dudley Water Dept.	Dudley	5,840	GW	1.2	1.81	1.0	l wellfield, l well
East Brookfield Water Dept.	E. Brookfield	1,200	GM	0.12	0.292	0.9	1 well
Mass. American Water Co. South Grafton Water Dist.	Grafton	5,332 2,810	GW	0.64 0.18	1.02	2.0 0.55	4 wells 2 wells
	Holland		No Public Water S	Supply			
Hopedale Water District	Hopedale	2,226	GW	0.38	0.42	0.42 0.10	wellfield Milford Water Co.(SW/GW)
Hopkinton Water Dept.	Hopkinton	5,700	GW	0.571	0.837	1.11	3 wells
Leicester Water Supply Dist. Hillcrest Water Dist. Cherry Valley & Rochdale W.D.	Leicester	2,700 350 4,400	GW GW SW	0.185 0.154 0.32	0.333 0.175 0.70	0.402 0.236 0.375	5 wells 3 wells Henshaw Pond
Milford Water Co.	Mendon	450	SW/GW				Included in Milford Syst.
Milford Water Co.	Milford	27,607	SW/GW	2.54	3.81	3.00	1.40 SW - Echo Lake 1.60 GW - wells Includes Mendon - 450 served Nopedale - 1667 served
Mass. American Water Co. Oakwood Heights Water Dist. Maple Hillside Water Dist.	Milbury	5,366 200 311	CW	1.16 0.0074 0.018	1.62 0.011 0.028	3.11	4 wells Mass. American Water Co. Mass. American Water Co.
	Millville		No Public Water S	upply	•	*	

TABLE 1 (Cont'd)
MAJOR WATER SUPPLIERS - SOUTH CENTRAL MASSACHUSETTS

			1980 Demands				
Company or Agency	Town Served	Est.Population Served - 1980	Source of Supply (SW or GW)	Avg.Day (MGD)	Max. Day (MGD)	Safe Yield (MGD)	Comments
Monson Water Dept.	Monson	5,000	GN/	0.95	1.70	1.73	2 wells, 1 standby
North Brookfield Water Dept.	N. Brookfield	3,600	sw	0.47	1.13	2.50	North Pond
Whitinsville Water Co.	Northbridge	10,340	G₩	1.14	1.65	2.55	2 wellfields, 1 emergency
Oxford Water Co.	Oxford	6,070	G₩	. 0.702	1.163	2.0	3 wells
Palmer Fire District Bondsville Fire & Water Dist. Three Rivers Fire Dist. Thorndike Fire & Water Dist.	Palmer	5,300 2,516 3,377 1,316	SW/GW GW GW	0.62 0.274 0.32 0.144	1.00 0.46 0.52 0.25	0.90 0.50 0.58	0.65 - 2 wells, 0.25 - Graves I 3 wells 2 wells From Bondsville supply
Shrewsbury Water Dept.	Shrewsbury	20,407	GW	2.56	4.44	4.18	2 wells, Worcester system
Southbridge Water Supply Co.	Southbridge	16,665	SW	1.71	2.56	2.95	4 reservoirs
Spencer Water Dept.	Spencer	5,000	SW/GW	0.37	0.55	1.30	1.0 - 1 well, 0.30 - Shaw Pond
Sturbridge Water Dept.	Sturbridge	3,884	GW	0.674	1.21	1.22	2 wells
Manchaug Water Dist. Wilkinsonville Water Dist.	Sutton	850 400	GW GW	0.016 0.10	0.024 0.15	0.045 0.282	3 wells I well
Upton Water Dept.	Upton	2,215	G₩	0.23	0.38	0.69	1 well, 1 wellfield
Uxbridge Water Dept.	Uxbridge	5,600	GW	0.67	0.97	2.1	3 wells
	Wales		No Public Water Supply				
Ware Water Dept.	Ware	7,200	GM	0.92	1.12	1.58	4 wells
West Warren Water Dist. Warren Water Dist.	Warren	1,078 2,644	GW GW	0.3 0.19	0.6 0.30	0.60 0.35	1 well, l standby 5 wells
Webster Water Dept.	Webster	14,200	CW.	1.29	1.94	3.50	2 wells & wellfield
W. Brookfield Water Dept.	W. Brookfield	2,200	GW	0.25	0.52	0.58	2 wells
Westborough Water Dept.	Westborough	13,346	SW/GW	2.02	2.5	2.78	0.75 - Westborough Res. 2.03 - 5 wells
Worcester DPW	Worcester	161,799	sw/cw	25.67	35.90	29.0	26.80 - reservoir system 2.20 - wells (2)

ഗ

Population Projections - South Central Massachusetts

Town	Actual 1980	1985	1990	1995	2000	Percent Change 1980-2000
Auburn	14,845	15,050	15,250	15,475	15,775	6.3
Blackstone	6,570	6,725	6,825	6,925	7,025	6.9
Brimfield	2,318	2,508	2,681	2,794	2,375	24.0
Brookfield	2,397	2,575	2,625	2,675	2,750	14.7
Charlton	6,719	7,050	7,500	7,675	8,075	20.2
Douglas	3,730	3,850	3,925	4,100	4,200	12.6
Dudley	8,717	9,050	9,200	9,400	9,725	11.6
East Brookfield	1,955	2,050	2,150	2,200	2,300	17.6
Grafton	11,238	11,450	11,750	11,975	12,175	8.3
Holland	1,589	1,902	2,193	2,430	2,578	62.2
Hopedale	3,905	4,000	4,125	4,150	4,200	7.6
Hopkinton	7,114	8,300	9,400	9,700	10,000	40.6
Leicester	9,446	9,600	9,700	9,950	10,075	6.7
Mendon	3,108	3,350	3,450	3,625	3,725	19.9
Milford	23,390	24,700	26,000	26,300	26,600	13.7
Millbury	11,808	12,175	12,450	12,725	12,925	. 9.5
Millville	1,693	1,750	1,800	1,825	1,875	10.8
Monson	7,315	7,688	8,026	8,427	8,823	20.6
North Brookfield	4,150	4,225	4,300	4,325	4,375	5.4
Northbridge	12,246	12,450	12,650	12,950	13,225	8.0
Oxford	11,680	12,100	12,350	12,725	12,925	10.7
Palmer	11,389	11,731	12,048	12,265	12,424	9.1
Shrewsbury	22,674	23,650	24,225	24,925	25,400	12.0
Southbridge	16,665	16,775	16,875	16,975	17,125	2.8
Spencer	10,774	11,200	11,600	12,025	12,225	13.5
Sturbridge	5,976	6,325	6,575	6,725	6,975	16.7
Sutton	5,855	6,350	6,725	6,950	7,225	23.4
Upton	3,886	4,125	4,225	4,425	4,525	16.4
Uxbridge	8,374	8,575	8,675	8,750	8,850	5.7
Wales	1,177	1,326	1,475	1,596	1,671	42.0
Ware	8,953	9,311	9,600	9,782	9,939	11.0
Warren	3,777	3,800	3,850	3,975	4,025	6.6
Webster	14,480	14,625	14,875	15,100	15,200	3.0
West Brookfield	3,026	3,100	3,150	3,175	3,250	7.4
Westborough	13,619	14,275	14,825	15,625	16,050	17.9
Worcester	161,799	161,800	161,800	161,800	161,800	1.0
TOTAL	448,357	459,516	468,873	476,444	482,910	7.7

and updated in 1981. This information indicates areas of potential future growth in the south-central Massachusetts area.

8. POTENTIAL FOR WATER SUPPLY REALLOCATION

- a. General. There are several authorities that provide for the use of reservoir storage for water supply at Corps of Engineers projects. They vary from the provision of water supply storage as a major purpose in new projects to the discretionary authority to provide emergency supplies to local communities in need. In addition, guidance contained in ER 1110-2-1941 directs field offices to determine the short-term water supply capability of existing Corps reservoirs that would be functional under existing authorities. Congressional authorization is not required to add municipal and industrial water supply if the related revisions in regulation would not significantly affect operation of the project for the originally authorized purpose.
- b. Drought Contingency Storage. It has been determined that a portion of the existing flood control storage at Hodges Village Dam could be utilized for emergency drought contingency storage without having an adverse impact on the project's flood control function. This infringement could use storage to a pool elevation of about 477 feet NGVD (11.5-foot stage). This represents a volume of about 1,000 acre-feet, equivalent to 325 million gallons or about 8 percent of the total reservoir storage.

Based on an all-season low flow duration analysis using 21 years of flow records for the gaging station on the French River at Hodges Village, it was determined that during a 10-year frequency drought period the volume of runoff could: a) fill the reservoir from invert elevation 465.5 to 477 feet NGVD in a 44-day summer period provided no releases were made from the dam. The storage at elevation 477 is equivalent to 1,000 acre-feet or 325 million gallons, b) fill the reservoir to elevation 477 in an 82-day summer period if a continuous release of about 3 cfs (0.10 cfs/sq. mi.) were maintained, or c) fill the reservoir to elevation 477 in about a three-week period in May if a continuous release of about 5 cfs were maintained. The water stored could be drawn directly from the reservoir or released downstream for municipal supply with proper treatment. Drought contingency storage versus flow duration at Hodges Village Dam is shown graphically on plate 3.

c. Effects of Regulated Flows. There is a possibility that curtailment of flows from Hodges Village Dam during the drought emergency could adversely impact on the flowage rights of downstream riparian users. At this time however, it is not possible to review all of the various drought emergency situations that could occur, nor is it within the scope of this report to identify all those with water rights. It is important to note that when a specific drought emergency situation does occur, the legal implications will need to be addressed.

9. WATER QUALITY EVALUATION

a. <u>Water Quality Classification</u>. The French River above and immediately downstream from Hodges Village Dam is rated class B by the Massachusetts Division of Water Pollution Control (MDWPC). Class B waters are designated for the protection and propagation of fish, other aquatic life and wildlife; and for primary and secondary contact recreation. Public water supply after treatment is not one of the uses given in Massachusetts Water Quality Standards for class B waters. However, a water which meets class B standards could be made potable with standard treatment processes.

The French River has been further designated as a warm water fishery. Technical requirements for class B warm water fisheries include a minimum dissolved oxygen concentration (DO) of 5 mg/l, a maximum temperature of 83°F, pH in the range of 6.5-8.0 standard units and fecal coliform bacteria not to exceed a log mean of 200 per 100 ml for a set of samples, nor shall more than 10 percent of the total samples exceed 400 per 100 ml during any monthly sampling period.

b. Existing Water Quality. Historically, the water quality along the length of the French River has ranged from fair at its origin in Sargent Pond to grossly polluted at Webster, Massachusetts and below. The causes of the water quality degradation were untreated and poorly treated municipal and industrial discharges.

Water quality in the French River has improved significantly in recent years. Charlton Woolen's discharge has ceased because the company went out of business. A significant source of nonpoint pollution, a road-salt stockpile near Rochdale Pond, Leicester, has been removed, but there is still a noticeable rise in chlorides in the river below this point. The untreated sewage outfall in Rochdale has

been diverted to the newly-built Oxford-Rochdale District Wastewater Treatment Plant (WWTP).

The remaining significant point source discharges upstream from Hodges Village Dam, in addition to the Oxford Rochdale WWTP, are CWM Electro-Plating Company (formerly Worcester Tool and Stamping Company) which discharges treated plating waste to the river, and the Leicester WWTP which has inadequate treatment but which is planned to be upgraded to secondary treatment by means of spray irrigation to land above Sargent Pond.

Water quality data collected by the Corps of Engineers and the Massachusetts Division of Water Pollution Control show that the waters of Hodges Village Dam are of generally good quality but do not fully meet the requirements of the Massachusetts class B designation. Areas of concern are low pH level and elevated coliform, nutrients, and iron levels. When the Leicester WWTP is upgraded the nutrients and coliform should be reduced to background levels. However, the low pH and high iron levels are due to the effects of swamps and bogs in the watershed and acid precipitation; therefore, no change is expected in these parameters.

- c. Soil Inundation Study. A study of the effect of inundating the soils in the Hodges Village reservoir area was conducted by the Corps Hydraulics and Water Quality Section, and reported in "Water Quality Control, Hodges Village Dam and Reservoir, Low Flow Augmentation Study", February 1982. It concluded that even if the nutrient levels in the river above Hodges Village Dam declined to background levels, and especially if they did not, large areas of the reservoir would need to be stripped of all organic material in order to maintain a high water quality in the impoundment. Of principal concern were the adverse water quality effects of algae blooms caused by high nutrient levels leached from the organic soils in the reservoir. Lesser concerns were high levels of color, iron, and turbidity and low DO levels in the depths of the pool.
- d. Water Quality Requirements for Drought Storage. There are two requirements to be met: the waters must meet State standards for surface waters and must be of a quality suitable for domestic or industrial water supply use. Class B waters are not designated for use as public water supply. However, a water which meets class B standards could be

made usable for public water supply without unusual treatment processes. The water quality required for industrial water supply depends on the specific industrial process involved.

Effects of Drought Storage. The impacts of creating a pool for drought storage at Hodges Village Dam will be very similar to the impacts of creating a pool for low flow augmentation. If the reservoir lands are stripped of organic material prior to inundation and the Leicester WWTP's effluent is upgraded, a high quality water will be stored in the reservoir. This water would meet class B standards and be usable for public water supply after adequate treatment. If the reservoir lands are not properly prepared for inundation or drought storage is begun before the Leicester WWTP's effluent is upgraded, a poor water quality degraded by algae blooms and elevated levels of color, turbidity, iron, manganese, taste and odor will result. Low levels of DO would occur in the deeper portions of the pool; however, the pool would be too shallow to stratify strongly and wind mixing would cause low DO levels to occur only intermittently. This water would still be usable for public water supply, but additional and possibly excessive treatment would be required. With or without additional treatment, the stored water would be usable for fire fighting and some industrial processes.

10. DISCUSSION OF IMPACTS

- a. General. Any action resulting in a temporary change of a reservoir's storage volume will have impacts on other project purposes which must be evaluated before a storage reallocation plan can be implemented. An evaluation has been made of the impacts resulting from drought contingency storage on the flood control purpose of this project. Effects on recreation, sedimentation and the aquatic and terrestrial environments as well as the historic and archeological resources have also been addressed.
- b. Flood Control. A review of the regulation procedures at Hodges Village Dam was undertaken to determine the volume of water that could be made available for drought contingency purposes. The water would be stored by temporarily utilizing existing flood control storage. It is recognized that major floods occur in every season of the year, thus any use of flood control storage would be continually monitored to insure there would be no adverse impacts on downstream flood protection.

At Hodges Village Dam the maximum pool-elevation for drought contingency storage has been estimated to be elevation 477 feet, representing an infringement on the flood control storage of about 0.6 inch of runoff from the upstream 31.1 square mile drainage area.

Based on a 10-year event, the anticipated rate of pool storage would exceed 0.1 foot per day over an 82-day period beginning in June. This condition assumes a flow of about 3 cfs (2 mgd) would be released downstream for the duration of the drought. Storage would probably take place during the months of June, July and August and would be drawn as needed in the following months. The storage may be held for a period of one month or longer at the 477-foot elevation before withdrawal.

- c. Recreation. Passive forms of recreation within the drought storage pool area such as hunting and fishing presently enjoyed by the public will be lost for the drought storage period and several years following until such time as the fishery can be reestablished and the vegetation replaced. Recreation associated with the existing tree cover, such as hunting and bird watching will be lost permanently.
- d. Project Operations. It is anticipated that it will be necessary to make frequent gate settings to build up the required storage while making a continuous minimum release. This requirement will continue after a pool of 11.5 feet is reached since no stoplog structure is available to maintain the pool. The pool level will be maintained by operation of the gates.

Significant cleanup efforts will be required in the reservoir after drawdown of the drought storage to remove debris, clear dead brush and trees. This material must be removed for aesthetic reasons and also to prevent it from clogging the intake and affecting flood control operations. Users of the proposed drought storage may be required to bear the expense of this removal and cleanup.

e. Effect on the Aquatic Ecosystem. The aquatic environment of the project area consists of the French River main stem and the impounded wetland just above the dam. The main stem is a moderate-sized warm water stream that generally ranges from 20-40 feet wide and from 2-4 feet deep. Streambank vegetation is generally thick and consists of a variety of riparian shrubs, trees and herbs. The warm

water conditions and moderate instream cover provide habitat for large-mouth bass, white sucker, sunfish, golden shiner and a variety of other warm water species. The impounded wetland above the dam creates a 2-3 foot deep pool which supports a variety of marsh vegetation. The impoundment and the river provide habitat for muskrat, mink, otter, waterfowl, wading birds and shorebirds.

Creating of the proposed temporary pool could impound up to 2.5 miles of the French River and the lower portion of its tributary, Wellington Brook. The stream habitat would be temporarily degraded by siltation and the influx of poorer quality water. Strict stream-associated vegetation and animals would probably be destroyed. Mobile forms such as fish, adult birds and aquatic mammals would be displaced from their existing habitats.

The impact on the fish population in the downstream French River would be related to the restricted downstream flows and the quality of the released water. Assuming a condition that drought storage would occur during the summer months, a minimum release of 3 cfs (2 mgd) would impose a low flow condition on the downstream main stem habitat throughout the duration of the drought. The lower stream levels and the poorer quality of the released water would further deteriorate the quality stream habitat in the cownstream area.

f. Effects on the Terrestrial Environment. The terrestrial environment in the project area consists of the upland and wetland forest and shrubland adjacent to the stream and marsh habitats described above. Approximately 635 of the 873 acres held in fee are forested and consist mainly of white and red oak, white pine, hickories, red maple, birches and hemlock. Shrubland consist primarily of Spirea spp., dogwood, arrowhead, blueberry and alder; leather lead and laurel occur in the bog areas. An unusual Atlantic white cedar swamp is located east of the French River and north of the Rocky Hill recreational area. Wildlife that use these habitats include white-tailed deer, fox, eastern chipmunk, racoon, owls, hawks, woodpeckers and a variety of other small mammals, songbirds, reptiles, amphibians and invertebrates. The State of Massachusetts annually stocks pheasants at the project area for hunting.

The proposed temporary impoundment would inundate about 245 acres of wetland forest and shrubland habitats during the growing season.

The majority of the upland habitat in the reservoir area would not be inundated. A significant storage during the growing season would kill tree species such as sugar maple, birches, beech, white pine, hemlock and oaks. Red maple and alder would probably be able to survive only one flooded season. Past inundation of the red maple swamps has led to considerable tree fall at the project. Most of the white cedar trees would probably survive a one-time inundation of their root systems. However, if drought storage were to coninue during subsequent years, the trees could exhibit significant loss.

The anticipated loss of vegetation would temporarily degrade wildlife habitat for most of the impounded area. Newly born or hatched young and some adult wildlife would probably perish in the rising waters. Others would be displaced on adjacent land where the habitat would probably be unable to support the added individuals.

g. Historic and Archeological Resources. Examination of mid-19th century maps reveal no recorded historic period resources below elevation 477 feet NGVD, and no prehistoric resources are recorded within the project. However, as the project has never been subjected to an archeological survey, unrecorded prehistoric or historic resources may exist within the area affected by this drought contingency plan. An archeological reconnaissance of this area is now underway as part of a low flow augmentation study. Therefore, should this plan proceed to more detailed study, results of the archeological reconnaissance survey will be included and further studies undertaken to determine what, if any, resources are affected and the severity of any impact upon them.

11. STUDY OF MODIFICATION OF HODGES VILLAGE DAM

- a. <u>General</u>. A separate study is currently underway that would modify the operation and structural element of the Hodges Village Dam to provide low flow augmentation for water quality improvement in the French River. Modifications to Hodges Village Dam and Reservoir would consists of clearing woody vegetation and selective stripping of organic topsoil in the reservoir area, and modifying one of the outlet gates at the dam.
- The U.S. Environmental Protection Agency has determined that low flow augmentation from Hodges Village Dam in combination with upgrading wastewater treatment plants in Leicester, Webster, and Dudley is the


only practical means of achieving State standards for surface waters in the lower portions of the French River. If a high quality discharge is made from Hodges Village Dam between the end of May and the end of October so that the flow at the U.S. Geological Survey gage in Webster does not fall below 22 cfs (14.2 mgd), State standards can be met in the river. To meet this target, a release of approximately 10 cfs from Hodges Village Dam would be required during augmentation periods.

To provide for low flow augmentation, the reservoir would be filled to elevation 475.6 feet NGVD each spring (May) and releases would be made from storage during the summer months, drawing the pool down to elevation 472 feet NGVD by the end of October. A permanent 90 acre pool (190 acrefeet) at elevation 472 (stage 6.5 feet) would be maintained the rest of the year. The net flow augmentation storage, between elevation 472 and 475.6, would be about 485 acre-feet.

b. Effects of Drought Storage. If Hodges Village is to be operated for low flow augmentation in the future then there will be no drought contingency storage filling capability during the summer season without adversely affecting its low flow function. With spring filling to elevation 475.6, providing 485 acre-feet of storage, the Hodges Village project can provide a 99 percent dependable flow of about 11 cfs. If, in preparation for a drought contingency, the project was filled in the spring to elevation 477 feet NGVD, then the project could supply a 99 percent dependable yield of 3 cfs or a total project yield of about 14 cfs.

12. SUMMARY AND CONCLUSIONS


Hydrologic studies indicate it would be possible to utilize up to approximately 1,000 acre-feet equivalent to 325 million gallons of flood control storage for drought emergency purposes, without having a significant adverse impact on the project's flood control effectiveness. However, under existing conditions in the reservoir, a poor quality water degraded by algae blooms and elevated levels of color, turbidity, iron, manganese, taste and odor will result; therefore, this project is not considered to be a good location for the storage of water for public water supply purposes during a drought emergency. The stored water may be acceptable for industrial water supply or related activities.

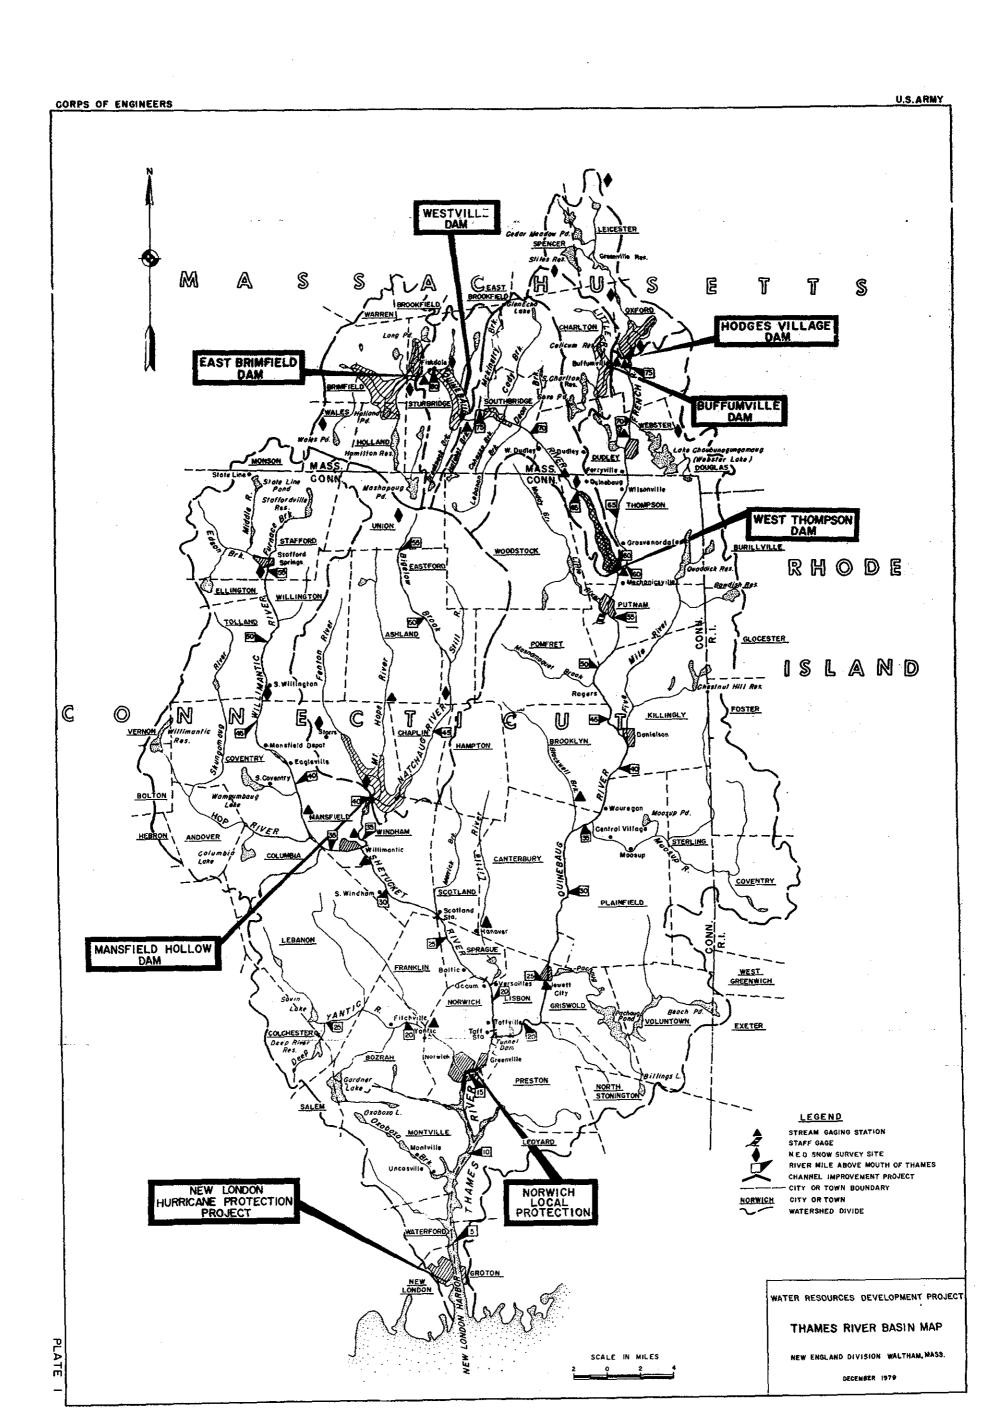

HODGES VILLAGE RESERVOIR AREA AND CAPACITY DRAINAGE AREA - 31.1 SQ. MI.

			Capaci		•			Capaci	ty
Elev.		<u>Area</u>	Acre-Feet	Inches	Elev.		Area	Acre-Feet	Inches
(ms1)	(feet)	(acres)			(ms1)	(feet)	(acres)		
		_							
465.5	0	0	0		1				
466.5	1	2 7	1	0	486.5	21	466	4,470	2.69
467.5	2		6	0	487.5	22	487	4,945	2.98
468.5	2 3 4	15	17	0.01	488.5	23	506	5,440	3.28
469.5	4	30	40	0.02	489.5	24	526	5,960	3.59
470.5	5	52	80	0.05	490.5	25	544	6,490	3.91
							•		
471.5	6 7	77	145	0.09	491.5	26	563	7,050	4.25
472.5	7	103	235	0.14	492.5	27	582	7,620	4.59
473.5	8	130	350	0.21	493.5	28	600	8,210	4.95
474.5	9	161	500	0.30	494.5	29	619	8,820	5.31
475.5	10	197	675	0.41	400.5	30	638	9,450	5.69
								·	
476.5	11	230	890	0.54	496.5	31	657	10,100	6.08
477.5	12	260	1,130	0.68	497.5	32	675	10,760	6.48
478.5	13	288	1,410	0.85	498.5	33	693	11,450	6.90
479.5	14	316	1,710	1.03	499.5	34	712	12,150	7.32
480.5	15	340	2,040	1.23	500.5	35	730	12,870	7.75
	• •				501	35.5	740	13,250	8.00
								•	
481.5	16	363	2,390	1.44					
482.5	17	385	2,765	1.67					
483.5	18	406	3,160	1.90					
484.5	19	427	3,575	2.15					
485.5	20	447	4,010	2.42				•	
		• • •	.,		•			•	

NOTES: Gate Sill Elev. = 465.5 Spillway Crest Elev. = 501.0 l" Runoff = 1,660 A.F.

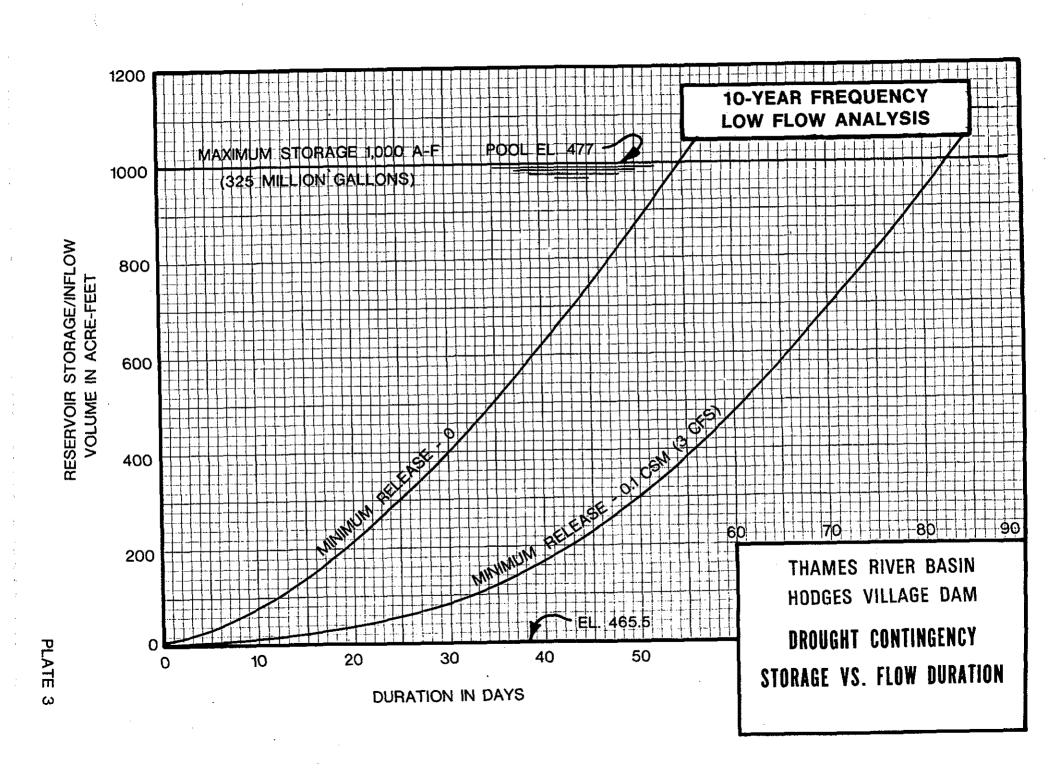

PERTINENT DATA HODGES VILLAGE DAM

LOCATION

French River, Oxford, Massachusetts

DRAINAGE AREA

31.1 square miles

STORAGE USES

Flood control

					Capacity		
RESERVOIR STORAGE	Elevation (ft msl)	Stage (feet)	Area (acres)	Acre- Feet	Inches on <u>Drainage Area</u>		
Inlet Elevation	465.5	0.0	0	0	0.0		
Spillway Crest	501.0	35.5	740	13,250	8.0		
Maximum Surcharge	515.1	49.6	-	_	-		
Top of Dam	520.0	53.5	-	-	-		

EMBANKMENT FEATURES

Rolled earth fill with rock slope protection

	<u>Length</u> (feet)	Top Width (feet)	Top Elevation (ft msl)	Height (feet)	Volume (cy)
Dam	2,140	22	520	54.5	126,000
Dike No. 1	1,205	16	520	15 <u>+</u>	-
Dike No. 2	200	16	520	6 <u>∓</u>	-
Dike No. 3	720	16	520	16 +	-
Dike No. 4	435	16	520	10∓	-

SPILLWAY

Location

Right (west) abutment

Chute spillway/concrete ogee weir 125 501

Type Crest Length (ft) Crest Elevation (ft msl) Surcharge (ft)
Maximum Discharge Capacity (cfs) 25,800 Spillway Design Flood Peak Inflow (cfs) 35,600 Peak Outflow (cfs) 25.800

OUTLET WORKS

Туре Tunnel Dimensions (ft) Two, Rectangular concrete conduits

5.0 wide x 6.0 high 206 Slide gate, electric Two, 5 wide x 6 high

Tunnel Length (ft)
Service Gate Type
Service Gate Size (ft) Emergency Gate Type Downstream Channel Capacity (cfs)

None 525 (non-growing season); 400 (growing season)

1,760 None

Maximum Discharge Capacity with Pool at Spillway Crest Elevation Stilling Basin

LAND ACQUISITION	Elevation (ft msl)	Stage (feet)	Area (acres)
Fee Taking	479	13.5	873
Easement	504	38.5	264

MAXIMUM POOL OF RECORD

Date March 1968 Stage (ft) 23.4 Percent Full

UNIT RUNOFF
One Inch Runoff (acre-ft)

1,660

OPERATING TIME

Open/Close all Gates

6 min. (manual operation; 144 turns/in.)

PROJECT COST
Through September 1977

\$4,421,000

DATE OF COMPLETION

1959

MAINTAINED BY

New England Division, Corps of Engineers Maintenance of recreation areas is shared by the Town of Oxford, Massachusetts and New England Division, Corps of Engineers

PLATE 4